



S.VENDEMIANO (TV)

SCHEMA DI INSTALLAZIONE
SCHEMA D'INSTALLATION
INSTALLATIONSPLAN
INSTALLATION DIAGRAM

MOD. 65/110 CFGG




CODICE

255.242.00

DATA 27-05-1999

Mod.65/110 CFGG

kW 33,3

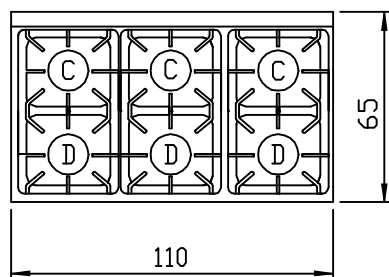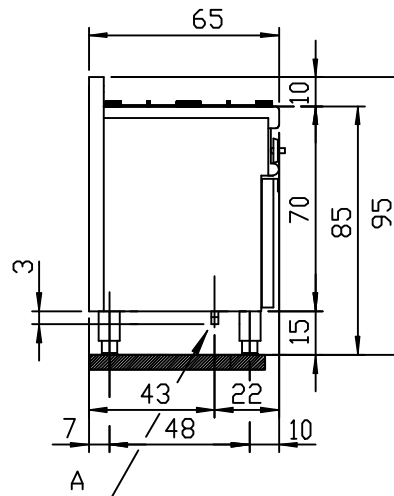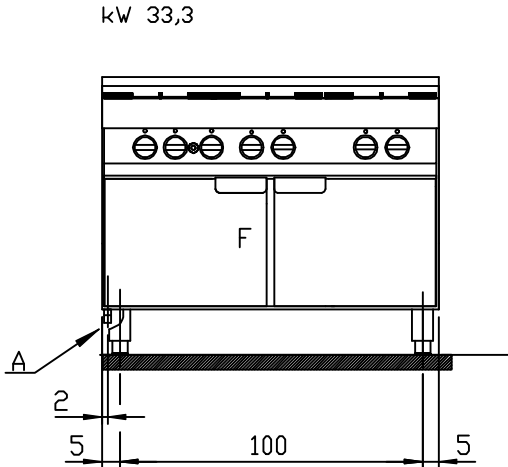

BRUCIATORI
BRULEURS
BRENNER
BURNERS

C = 3,6 kW

D = 5 kW

F = 7,5 kW

A = Attacco gas 1/2 "G conica
Arrivée gaz 1/2 "G
Gasanschluss 1/2 "G DIN 2999
Gas inlet 1/2 "G
Pour France Denmark
Arrivée gaz 1/2 "G ISO 228-1

ISO 7-1

Tipo di apparecchi A :

I suddetti prodotti sono stati approvati per

AT	I ₂ H3B/P	BE	I ₂ E+3+	DE	I ₂ ELL3B/P
DK	I ₂ H3B/P	ES	I ₂ H3+	FI	I ₂ H3B/P
FR	I ₂ E+3+	GB	I ₂ H3+	GR	I 3+
IE	I ₂ H3+	IT	I ₂ H3+	LU	I ₂ E3B/P
NL	I ₂ L3B/P	NO	I 3B/P	PT	I ₂ H3+
SE	I ₂ H3B/P	CH	I ₂ H3B/P		
		CH	I ₂ H3+		

SOSTITUISCE PARI NUMERO DEL